

Technical information p. 100  
 Dimensions p. 103

Conform to IEC/EN 61095  
 Space for power supply busbar on top (up to 25 A)

Pack	Cat. Nos.	Power contactors with 24 V~ coil			
1	4125 03	<b>Double pole - 250 V~</b> I max 16 A		Type of contact N/C + N/O	Number of modules 1
	4125 05	25 A		2 N/O	1

Pack	Cat. Nos.	Power contactors with 230 V~ coil			
4	4125 21	<b>Double pole - 250 V~</b> I max 16 A		Type of contact N/C + N/O	Number of modules 1
	4125 24	25 A		2 N/C	1
5	4125 35	<b>Four pole - 400 V~</b> 25 A		4 N/O	2
	4125 36	25 A		4 N/C	2
	4125 33	25 A		2 N/C + 2 N/O	2



Pack	Cat. Nos.	Signalling auxiliaries for CX <sup>3</sup> contactors			
1	4124 29	Auxiliary changeover switch Used to signal the position status of the contacts on the product to which it is connected			
		<b>For 1 module contactors 16 A to 25 A</b> Maximum 2 auxiliary devices per contactor Fitted on left-hand side of contactor			
		I max 5 A	Voltage 250 V~	Contact N/C + N/O	Number of modules 0.5
		<b>For 2 module contactors 25 A</b> Maximum 2 auxiliary devices per contactor Fitted on left-hand side of contactor			
1	4124 30	Maximum 2 auxiliary devices per contactor Fitted on left-hand side of contactor			
		I max 5 A	Voltage 250 V~	Contact N/C + N/O	0.5
1	4124 31	<b>For 63 A contactors</b> Maximum 1 auxiliary device per contactor Fitted on left-hand side of contactor			
		I max 5 A	Voltage 250 V~	Contact N/C + N/O	0.5
10	4063 07	<b>Accessory</b> Spacing unit 0.5 module To be placed between every 2 contactors to aid cooling			



**NEW**

# power contactors CX<sup>3</sup> with handle

16 A to 63 A

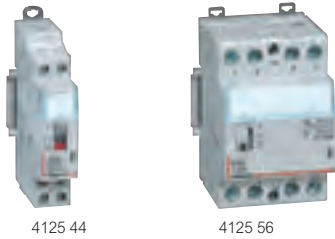

Technical information **p. 100**  
Dimensions **p. 103**

Conform to IEC/EN 61095  
Space for power supply busbar on top (up to 25 A)

Pack	Cat. Nos.	<b>Power contactors with 230 V~ coil and handle</b>			
		Manual override for test and repair function, carried out via the handle Permanent "ON" or "OFF" without automatic reset			
		<b>Double pole - 250 V~</b>			
4	4125 44	I max	Connection	Type of contact	Number of modules
1	4125 45 <sup>1</sup>	25 A		2 N/O	1
1	4125 47 <sup>1</sup>	40 A		2 N/O	2
1	4125 47 <sup>1</sup>	63 A		2 N/O	2
		<b>Triple pole 400 V~</b>			
1	4125 49 <sup>1</sup>	40 A		3 N/O	3
1	4125 50 <sup>1</sup>	63 A		3 N/O	3
		<b>Four pole 400 V~</b>			
1	4125 53 <sup>1</sup>	40 A		4 N/O	3
1	4125 56 <sup>1</sup>	63 A		4 N/O	3

Pack	Cat. Nos.	<b>Signalling auxiliaries for CX<sup>3</sup> contactors</b>			
		Auxiliary changeover switch Used to signal the position status of the contacts on the product to which it is connected			
		<b>For 1 module contactors 16 A to 25 A</b>			
		Maximum 2 auxiliary devices per contactor Fitted on left-hand side of contactor			
1	4124 29	I max	Voltage	Contact	Number of modules
		5 A	250 V~	N/C + N/O	0.5
		<b>For 2 module contactors 25 A</b>			
		Maximum 2 auxiliary devices per contactor Fitted on left-hand side of contactor			
1	4124 30	5 A	250 V~	N/C + N/O	0.5
		<b>For 40 and 63 A contactors</b>			
		Maximum 1 auxiliary device per contactor Fitted on left-hand side of contactor			
1	4124 31	5 A	250 V~	N/C + N/O	0.5
		<b>Accessory</b>			
10	4063 07	Spacing unit 0.5 module To be placed between every 2 contactors to aid cooling			



1 : Handle can be accessed after removing blanking plate

Download the full file at

<http://assets.kempstoncontrols.com/doc/Legrand%20Industrial%20and%20power%20protection%20catalogue.pdf>



**KEMPSTON**  
CONTROLS