Features

- Interface between the I/O modules and the PCS/PLC
- · Com unit for 80 analog or 184 digital channels
- Communication via PROFIBUS DP
- Mounting in Zone 2, Class I/Div.2 or in the safe area
- HART communication via PROFIBUS DP V1 or service bus
- Configuration via FDT 1.2 DTM
- Configuration in run (CiR) for any PCS
- Non-volatile memory for configuration and parameter settings
- Self configuration in redundant systems
- Permanently self-monitoring
- · Outputs drive to safe state in case of failures
- Module can be exchanged under voltage


Function

The PROFIBUS com unit forms the interface between the I/O modules on the backplane and the process control system.

It supports all single width and dual width I/O modules. Thereby signals from NAMUR sensors, mechanical contacts, high-power solenoid drivers, power relays, sounders, and alarm LEDs are transported to the higher-level bus system.

The com unit can be easily configured via DTM and supports redundancy as well as HART.


Configuration in Run (CiR) enables configuration of a running system without a PROFIBUS restart, even in non-redundant systems.

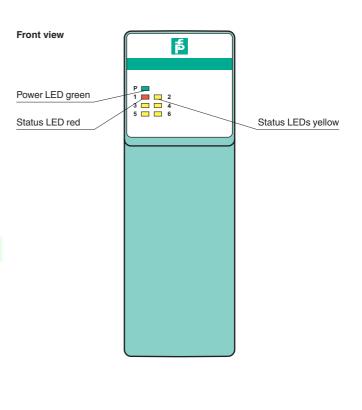

CE (8

Assembly

Connection

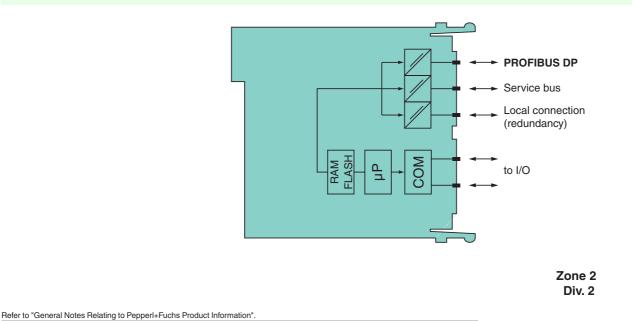

Pepperl+Fuchs Group www.pepperl-fuchs.com pa

USA: +1 330 486 0002 pa-info@us.pepperl-fuchs.com Germany: +49 621 776 2222 pa-info@de.pepperl-fuchs.com Singapore: +65 6779 9091 pa-info@sg.pepperl-fuchs.com



Supply	
Connection backplane bus	
Rated voltage U_r 5 V DC , only in connection with the pow	er sunnlies I BQ***
Power dissipation 1.8 W	
Power consumption 1.8 W	
Fieldbus interface	
Fieldbus type PROFIBUS DP/DP-V1	
PROFIBUS DP	
Connection 9-pin Sub-D socket via backplane	
Baud rate up to 1.5 MBit/s	
Protocol PROFIBUS DP/DP V1 read/write service	e
Number of stations per bus line ≤ 125 (PROFIBUS), ≤ 119 (service bus)	
Cyclic process data 240 bytes input and (simultaneously) 240	
Number of stations per bus segment ≤ 31 (RS-485 standard)	, by ice output
Number of repeaters between Master max. 3	
and Slave	
Supported I/O modules all LB remote I/O modules	
Configuration (240 bytes I/O) Standard: 80 analog, 184 digital	
Universal 2I2O: 48 analog, 184 digital Universal 4I4O: 60 analog, 120 digital	
Bus length \leq 1000 m (FOL, 1.5 MBaud),	
\leq 1000 m (copper cable, 187.5 kBd), \leq 200 m (copper cable, 1.5 MBd)	
Addressing via configuration software	
PROFIBUS address 0 126	
(factory standard setting: 126)	
GSE file PFV61711.gsd/gse	
HART communication via PROFIBUS or service bus	
Internal bus	
Connection backplane bus	
Redundancy via backplane	
Indicators/settings	
LED indication LED P: (power supply): On = operating, f LED 1: (collective alarm): On = internal fa LED 2: (operating mode): flashing 1 (1:1 simulation LED 3: (status fieldbus): flashing = fieldb LED 4: (status fieldbus): flashing = fieldb LED 5: (status service bus): flashing = se LED 6: (status service bus): flashing = se	ult, flashing = no fieldbus connection ratio) = active, normal operation; flashing 2 (7:1 ratio) = active, us receive channel active us response channel active rvice bus receive channel active
Directive conformity	
Electromagnetic compatibility	
Directive 2014/30/EU EN 61326-1	
Conformity	
Electromagnetic compatibility NE 21	
Degree of protection IEC 60529	
Fieldbus standard IEC 61158-2	
Environmental test EN 60068-2-14	
Shock resistance EN 60068-2-27	
Vibration resistance EN 60068-2-6	
Damaging gas EN 60068-2-42	
Relative humidity EN 60068-2-56	
Ambient conditions	
Ambient temperature -20 60 °C (-4 140 °F)	
Storage temperature -25 85 °C (-13 185 °F)	
Relative humidity 95 % non-condensing	
Shock resistance shock type I, shock duration 11 ms, shoc	
cycles	frequency: 57.56 Hz, amplitude/acceleration \pm 0.075 mm/1 g; 10 equency: 13.2 Hz amplitude/acceleration \pm 1 mm/0.7 g; 90 minutes at
Damaging gas designed for operation in environmental	conditions acc. to ISA-S71.04-1985, severity level G3
Mechanical specifications	
moonamour opeomouriono	
Degree of protection IP20 (module) , mounted on backplane	
-	
Degree of protection IP20 (module) , mounted on backplane	

 Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

 Pepperl+Fuchs Group
 USA: +1 330 486 0002
 Getwww.pepperl-fuchs.com

 www.pepperl-fuchs.com
 pa-info@us.pepperl-fuchs.com
 pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222 pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091 pa-info@sg.pepperl-fuchs.com

EPEPPERL+FUCHS

2

Data for application in connection with hazardous areas	
Certificate	PF 08 CERT 1234 X
Marking	⟨͡ɕ⟩ II 3 G Ex nA IIC T4 Gc
Directive conformity	
Directive 2014/34/EU	EN 60079-0:2009 EN 60079-11:2007 EN 60079-15:2010
International approvals	
ATEX approval	PF 08 CERT 1234 X
UL approval	E106378
Control drawing	116-0321
Approved for	cUL (Canada): CL I Zn. 2 IIC; IS circuits for CL I Zn. 0 IIC ULus (USA): CL I Div. 2 Grp. A, B, C, D; IS circuits for CL I, II, III Div. 1 Grp. A, B, C, D, E, F, G
IECEx approval	BVS 09.0037X
Approved for	Ex nA IIC T4 Gc
EAC approval	Russia: RU C-IT.MIII06.B.00129
Marine approval	
Lloyd Register	15/20021
DNV GL Marine	TAA0000034
American Bureau of Shipping	T1450280/UN
Bureau Veritas Marine	22449/B0 BV
General information	
System information	The module has to be mounted in appropriate backplanes (LB9***) in Zone 2 or outside hazardous areas. Here, observe the corresponding declaration of conformity. For use in hazardous areas (e. g. Zone 2, Zone 22 or Div. 2) the module must be installed in an appropriate enclosure.
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com.

Germany: +49 621 776 2222 pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091 pa-info@sg.pepperl-fuchs.com