

# Instruction Leaflet for Undervoltage Release (UVR) for EG/JG/LG Circuit Breakers and Motor Circuit Protectors

## 1.0 UNDERVOLTAGE RELEASE KIT

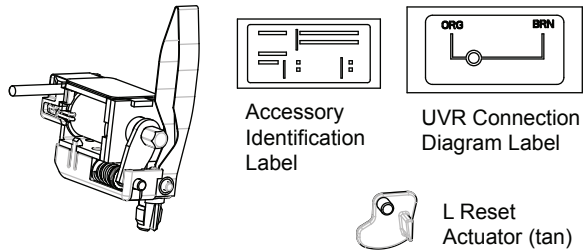


Figure 1-1 UVR kit

70 and 35 percent of the solenoid coil rating. The UVR consists of a continuous rated solenoid with a plunger and tripping lever. The UVR is reset when normal voltage is restored and the circuit breaker handle is moved to the reset (OFF) position.

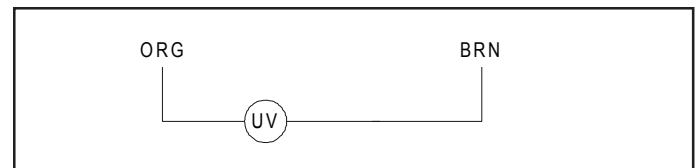


Figure 2-1 UVR connection diagram

## 2.0 GENERAL INFORMATION

The Undervoltage Release (UVR) monitors a voltage (typically a line voltage) and trips the circuit breaker when the voltage at the wire leads falls to between

Table 2-1 UVR application and electrical operating rating data

Catalog Number	Application Ratings		Electrical Operating Ratings					One Minute Dielectric Withstand Voltage, U <sub>i</sub>
	Voltage, U <sub>e</sub>	Frequency	Supply Voltage, U <sub>s</sub>	Dropout Voltage		Pickup Voltage Max.	VA	
				Min.	Max.			
UVR012APK	12	50-60 Hz	12	4.2	8.4	10.2	0.95	1024
UVR012DPK	12	DC	12	4.2	8.4	10.2	0.88	1024
UVR024APK	24	50-60 Hz	24	8.4	16.8	20.4	0.72	1048
UVR024DPK	24	DC	24	8.4	16.8	20.4	0.70	1048
UVR048APK	48-60	50-60 Hz	48 60	21.0	33.6	40.8	1.15 1.78	1120
UVR048DPK	48-60	DC	48 60	21.0	33.6	40.8	1.12 1.76	1120
UVR120APK	110-127	50-60 Hz	110 120 127	44.5	77.0	93.5	0.96 1.13 1.25	1254
UVR125DPK	110-125	DC	110 120 125	43.8	77.0	93.5	0.94 1.12 1.21	1250
UVR240APK	208-240	50-60 Hz	208 220 240	85.0	146	177	1.28 1.42 1.68	1480
UVR250DPK	220-250	DC	220 250	87.5	154	187	1.45 1.86	1500
UVR480APK	380-500	50-60 Hz	380 415 440 480 500	175	266	323	2.2 2.7 3.0 3.6 3.9	2000
UVR600APK	525-600	50-60 Hz	525 550 600	210	367	446	3.4 3.7 4.3	2200

## 3.0 INSTALLATION




### WARNING


DO NOT ATTEMPT TO INSTALL OR PERFORM MAINTENANCE ON EQUIPMENT WHILE IT IS ENERGIZED. DEATH OR SEVERE PERSONAL INJURY CAN RESULT FROM CONTACT WITH ENERGIZED EQUIPMENT. ALWAYS VERIFY THAT NO VOLTAGE IS PRESENT BEFORE PROCEEDING. ALWAYS FOLLOW SAFETY PROCEDURES. CUTLER-HAMMER IS NOT LIABLE FOR THE MISAPPLICATION OR MISINSTALLATION OF ITS PRODUCTS.

- ①** Remove the breaker cover and sleeve.

#### EG Frame

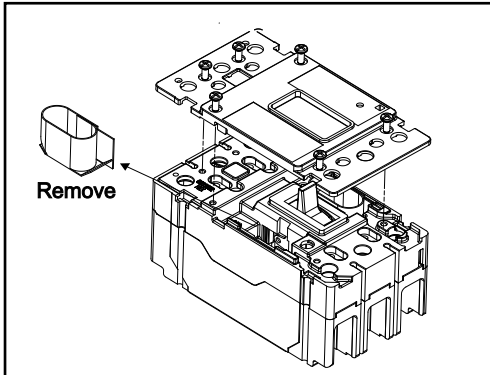


- ②** Remove hex nut and install UVR (left pole only).

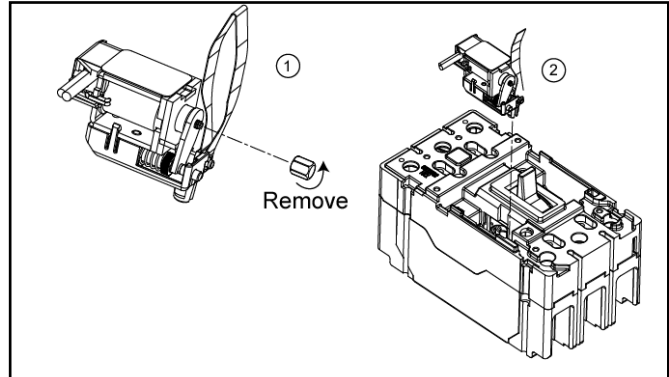


- ①** Remove the breaker cover and sleeve.

#### JG Frame

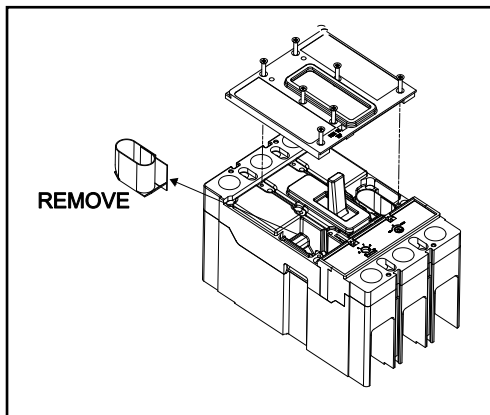


- ②** Install UVR (left pole only).

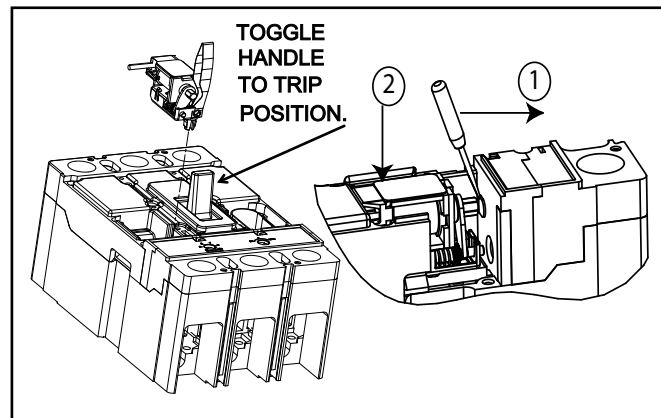


- ①** Remove the breaker cover and sleeve.

#### LG Frame

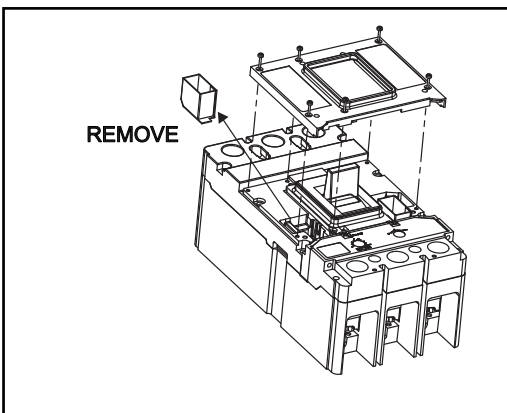


- ②** Install LG Actuator and UVR (left pole)

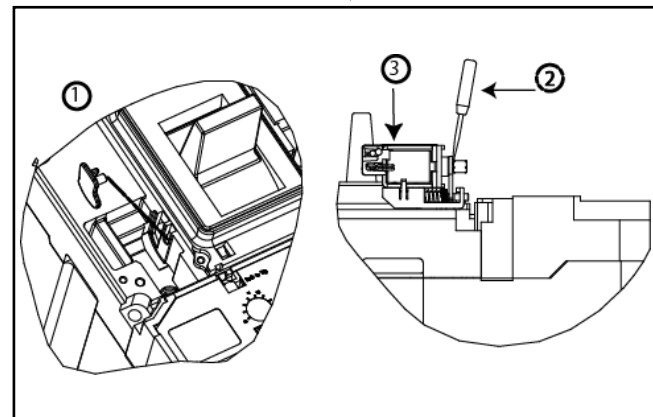


## ③ Wire routing options.


NOTE: Break off side tab on cover if routing wires through side opening.

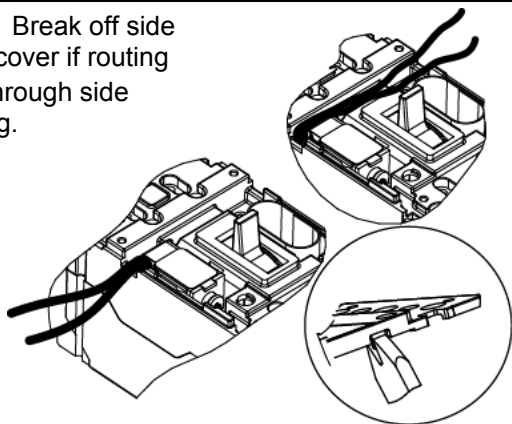


## ④ Re-install breaker cover.

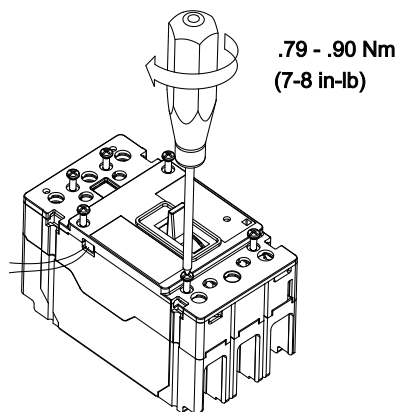


## ③ Route wires.

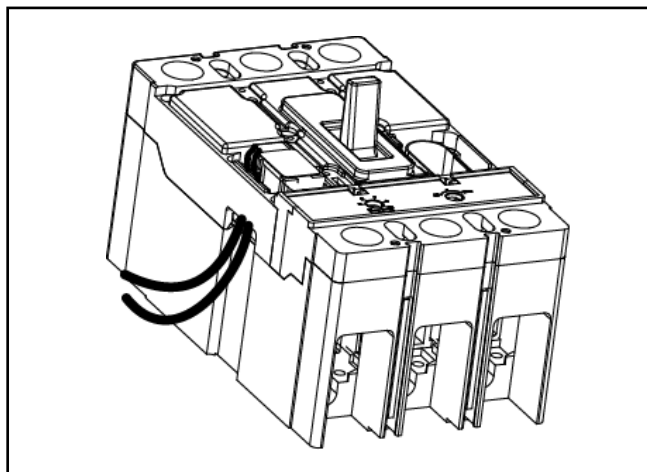


## ④ Re-install breaker cover.

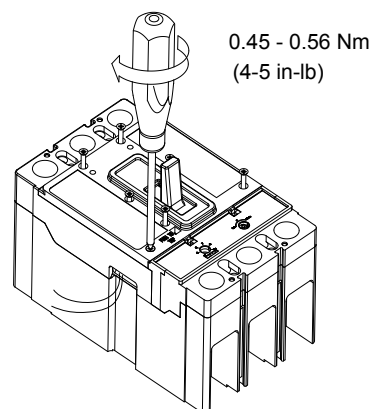

## ③ Route wires.

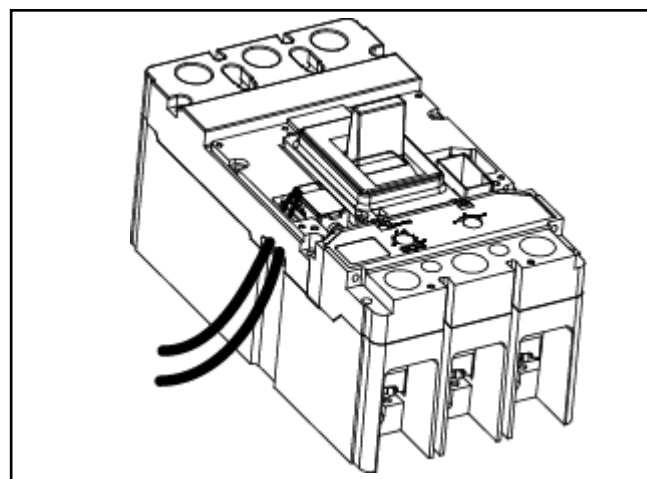

## ④ Re-install breaker cover.

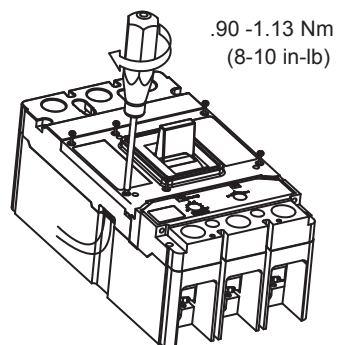

**5** Apply labels.

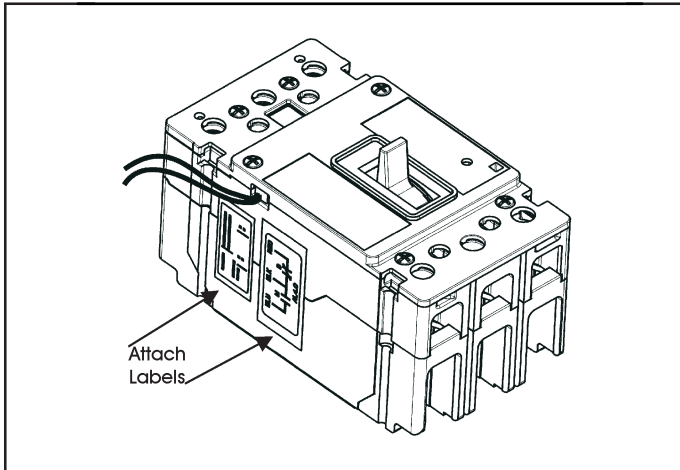


Figure 3-5 Accessory Identification Label and Circuit Diagram Label application

**5.0 REMOVAL**

Removal is the reverse of the installation procedure. Remove the UVR by pulling straight up on pull tab (see Figure 5-1). Be sure to reinstall the sleeve removed in Section 3.0, step 1.

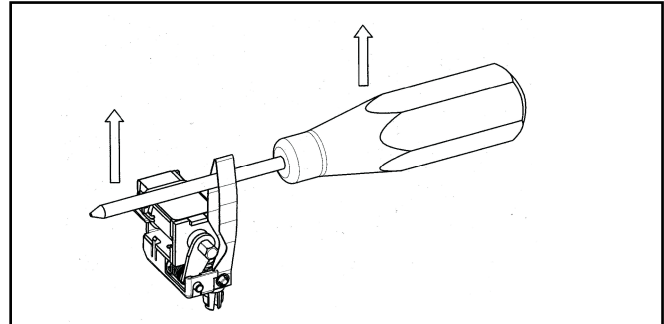


Figure 5-1 UVR removal

**4.0 TESTING**

Refer to figure 4-1.

**Step 1:** With no voltage applied to UVR, ensure that the breaker handle cannot be set to the **Closed (ON)** position.

**Step 2:** Set Breaker to **Reset** position. **After taking all necessary precautions**, apply rated voltage to UVR, and ensure that breaker handle can be set to the Closed (ON) position.

**Step 3:** **Disconnect voltage from UVR and ensure that** breaker handle moves to the TRIP position.

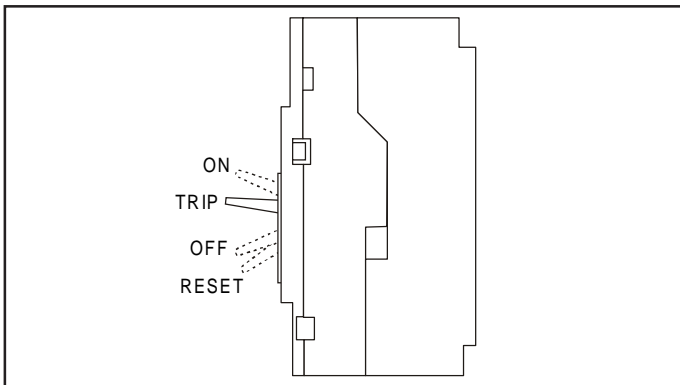


Figure 4-1 Circuit Breaker/Motor Circuit Protector handle Open (OFF), Closed (ON), and TRIP positions